
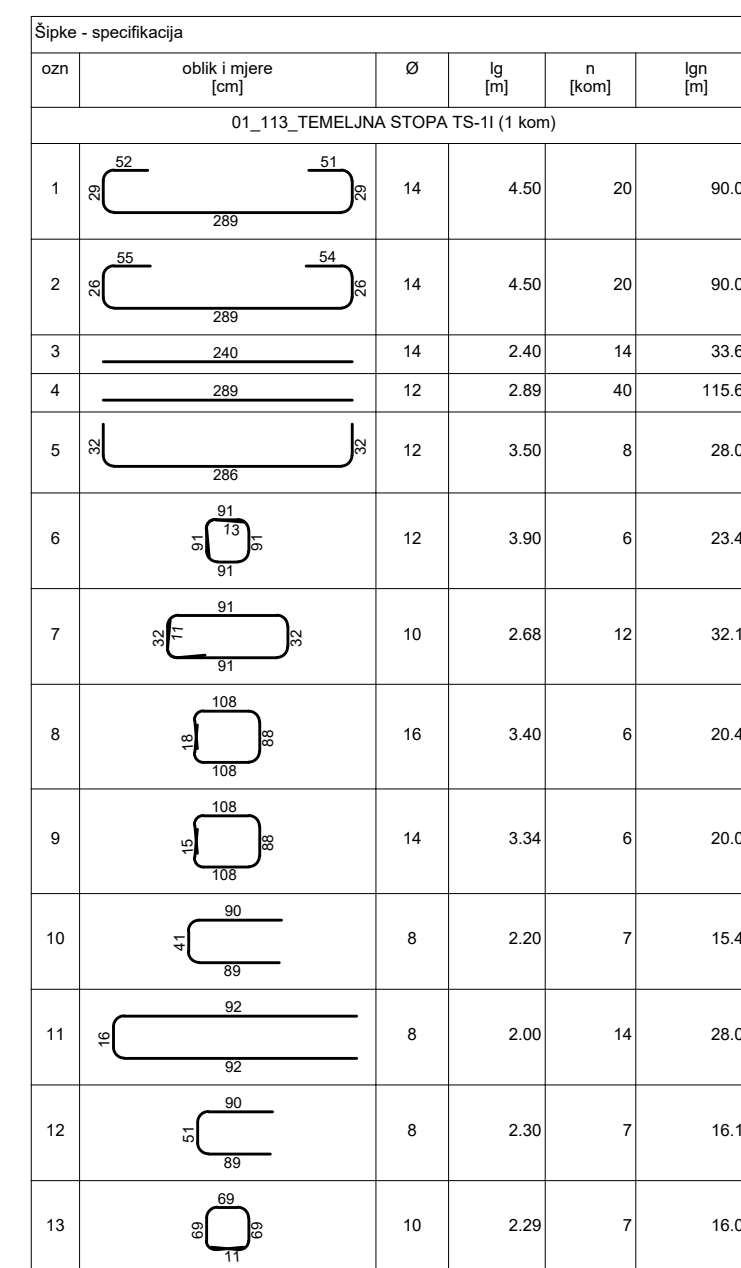










M 1:25



14		10	2.20	7	15.40
15		20	3.00	7	21.00
16		20	4.50	7	31.50
17		10	3.15	8	25.20
18		8	1.20	7	8.40
19		10	1.28	12	15.36
20		10	1.34	9	12.06
21		14	1.06	36	38.16
Šipke - rekapitulacija					
Ø [mm]	lgn [m]	Jedinična težina (kg/m)		Težina [kg]	
B500					
8		67.90	0.41	27.50	
10		116.21	0.63	73.68	
12		167.00	0.91	152.14	
14		271.80	1.24	337.58	
16		20.40	1.62	33.07	
20		52.50	2.54	133.14	
Ukupno (B500)				757.10	
Ukupno				757.10	

NAPOMENA:
TEMELJE IZVESTI NA DOBRO PORAVNATOKU I ZBIJENOJ PODLOZI NA KOJU JE POTREBNO ILITI 5 cm PODLOŽNOG BETONA C12/15.
SVE MJERE USKLADITI S ARHITEKTONSKIM PODLOGAMA TE IH KONSTRUIRATI NA TERENU.
SVE NEUSKLADENOSTI, DVOSMISLENOSTI I NEDOREČENOSTI U NACRTIMA USKLADITI S AUTORIMA SPORNIH NACRTA.
PRIJE ARMIRANJA OBAVEZNO PREGLEDATI NACRTE KONSTRUKTIVNIH ELEMENATA VEŽANIH ZA OVIM NACRTOM PRIKAZANU KONSTRUKCIJU. U SLUČAJU NEJASNOĆA KONTAKTIRATI PROJEKTANTA ILI NADZORNOG INŽENJERA.
SVE KONSTRUKTIVNE ELEMENTE MEĐUSOBNO KRUŽO POVEZATI.
RADNE REŠKE OSIGURATI ISTEG MREŽAMA, TE PREMA POTREBI BRTVITI.
TEMELJE BETONIRATI U DNEVNIM TAKTOVIMA TE IH DEFINIRATI NA GRADILIŠTU OVISNO O TEHNOLOGIJI IZVEDBE U DOGOVORU SA NADZORNIM INŽENJEROM.
MINIMALNI PREKLOP ARMATURNIH ŠIPKI = 50 Ø
PRODORE USKLADITI SA NACRTIMA INSTALACIJA. SVE PRODORE VEĆE OD 25x25 cm ADEKVATNO OJAČATI, ODNOSNO ARMIRATI PREMA POSEBOM DETALJU.

ANKERI ZA STUPOVE

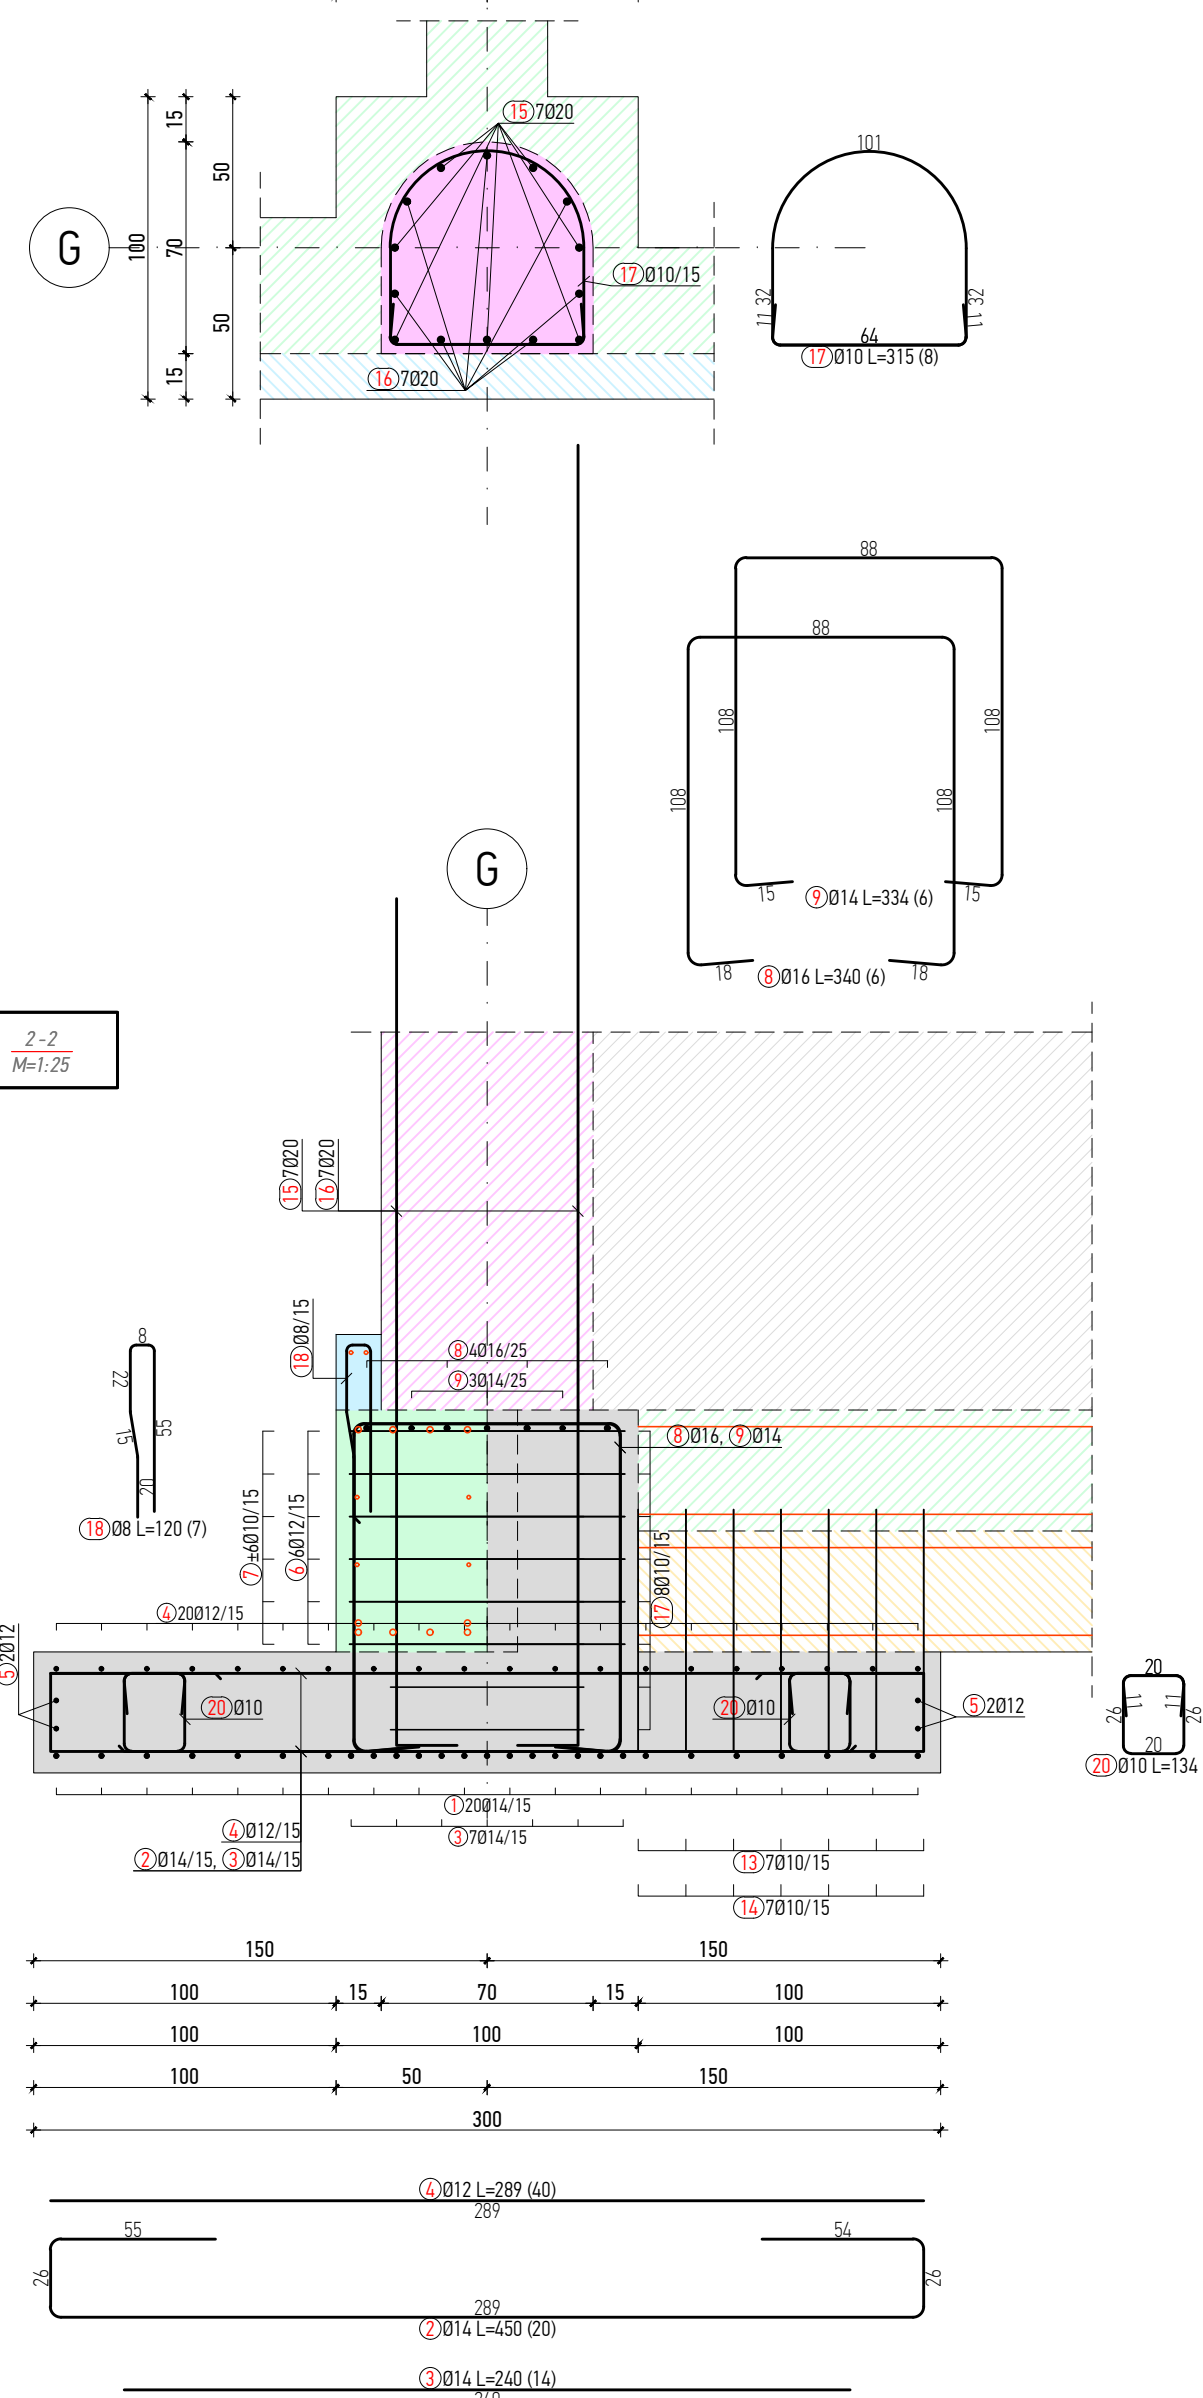

GRADIVO:
BETON: C25/30, XC2
ARMATURA:
ŠIPKE: B500B
debljina zaštitnog sloja:
TEMELJNA STOPA
 $C_{nom} = C_{min} + \Delta C_{dev}$
 $C_{nom} = 4,0 + 1,0$
 $C_{nom} = 5,0$ cm
NADTEMELJ
 $C_{nom} = C_{min} + \Delta C_{dev}$
 $C_{nom} = 3,0 + 1,0$
 $C_{nom} = 4,0$ cm

